

SOUTHERN NEVADA BUILDING OFFICIALS REGIONAL STANDARDS

M-105 11-02-05 Pg. 1 of 1

OPTIONAL DUCT SMOKE DETECTOR INSTALLATION

OPTIONAL METHOD FOR DUCT SMOKE DETECTOR INSTALLED TO PROVIDE WEATHER PROTECTION AND ACCESS TO SMOKE DETECTOR FOR PURPOSES OF SHUTOFF OF AIR MOVING SYSTEM FOR COMPLIANCE UMC CHAPTER 6. SMOKE DETECTOR MUST BE INSTALLED IN ACCORDANCE WITH ITS LISTING AND IN THE MAIN SUPPLY AIR DUCT.

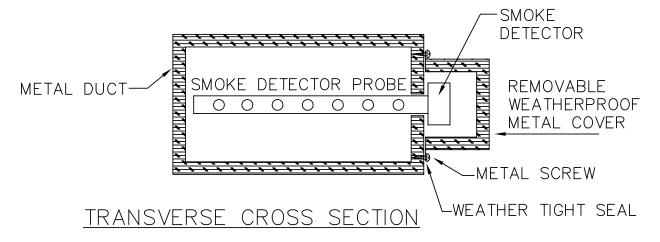

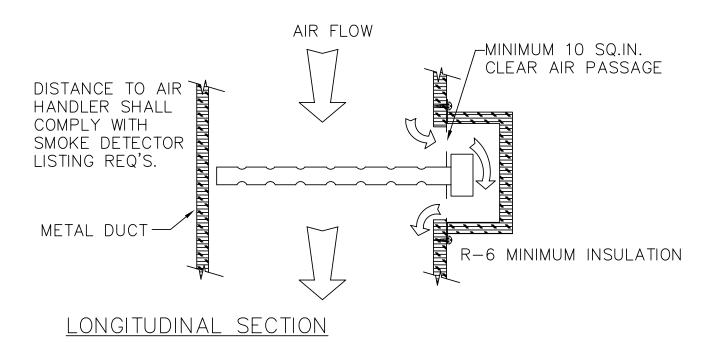

Clark County Dept. of Develop. Services

Dept. of Develop. Services 4701 W Russell Rd Las Vegas NV 89118 (702) 455-3000

Boulder City Building Department 401 California Avenue

401 California Avenue Boulder City, NV 89005 (702) 293-9282

Henderson

Bldg & Fire Safety Dept. 240 Water St. Henderson, NV 89015 (702) 267-3650

Las Vegas

Building & Safety Dept. 731 S. 4th Street Las Vegas, NV 89101 (702) 229-6916

Mesquite

Building Department 10 East Mesquite Blvd. Mesquite NV. 89027 (702) 346-2835

North Las Vegas Building Department 2266 Civic Center Drive N. Las Vegas, NV 89030 (702) 633-1577